



# FLIR IRW-3C: 3in Round Infrared Inspection Window (Aluminum)

**P/N: 19251-100**

**Copyright**

© 2020, FLIR Systems, Inc.

All rights reserved worldwide. Names and marks appearing herein are either registered trademarks or trademarks of FLIR Systems and/or its subsidiaries. All other trademarks, trade names or company names referenced herein are used for identification only and are the property of their respective owners.

**Document identity**

Publ. No.: 19251-100

Commit: 57381

Language:

Modified: 2019-05-22

Formatted: 2020-06-17

**Website**

<http://www.flir.com>

**Customer support**

<http://support.flir.com>

**Disclaimer**

Specifications subject to change without further notice. Camera models and accessories subject to regional market considerations. License procedures may apply. Products described herein may be subject to US Export Regulations. Please refer to [exportquestions@flir.com](mailto:exportquestions@flir.com) with any questions.



<b>General description</b>	
This device is a viewport which consist of a crystal "glass" window, mounted in an aluminum frame. The glass is specially formulated to allow transmission of infrared light to allow use of infrared thermal sensing equipment without opening the enclosure. This device is intended for installation in doors or walls of electrical enclosures without compromising the integrity of the enclosure.	
<b>Power system</b>	
Voltage	Any range
<b>Environmental data</b>	
Environment	Indoor/outdoor type 4/12
Operating temperature range	Maximum: 260°C (500°F)
Storage temperature range	Optics, maximum: 1357°C (2474°F)
<b>Physical data</b>	
Size (L x W x H)	26.9 x 99 x 107 mm (1.05 x 3.89 x 4.22 in.)
Viewing aperture diameter	69 mm (2.71 in.)
Material	Optics: CaF2 (Calcium Fluoride Crystal) Body: Anodized aluminum Hardware: steel
Comments to physical data	Required hole diameter, nominal: 88.9 mm (3.5 in.) Greenlee Punch: 739BB Maximum pullout strength: 1656 kg (3650 lb.)
<b>Lens</b>	
Waveband	Broadband IR: short-, mid-, and longwave
Visible light spectrum	Yes
<b>Certifications</b>	
Certification	UL, IP67, NEMA Type 4/12, CSA
<b>Shipping information</b>	
Packaging, type	Cardboard box
List of contents	<ul style="list-style-type: none"><li>IR window</li><li>Case</li><li>Mounting instruction</li><li>Additional safety screw</li></ul>
Packaging, weight	0.39 kg (0.86 lb.)



# FLIR IRW-3C: 3in Round Infrared Inspection Window (Aluminum)




**P/N: 19251-100**

© 2020, FLIR Systems, Inc.

#19251-100; r. 57381;

Shipping information	
Packaging, size	130 × 140 × 40 mm (5.12 × 5.51 × 1.58 in.)
EAN-13	4743254000735
UPC-12	845188002824
Country of origin	Estonia

© 2015, FLIR Systems, Inc. All rights reserved worldwide. No part of this drawing may be reproduced, stored in a retrieval system, or transmitted in any form, or by any means, electronic, mechanical, photocopying, recording, or otherwise, without written permission from FLIR Systems, Inc. Specifications subject to change without further notice. Dimensional data is based on nominal values. Products may be subject to regional market considerations. License procedures may apply. Product may be subject to US Export Regulations. Please refer to exportquestions@flir.com with any questions. Diversion contrary to US law is prohibited

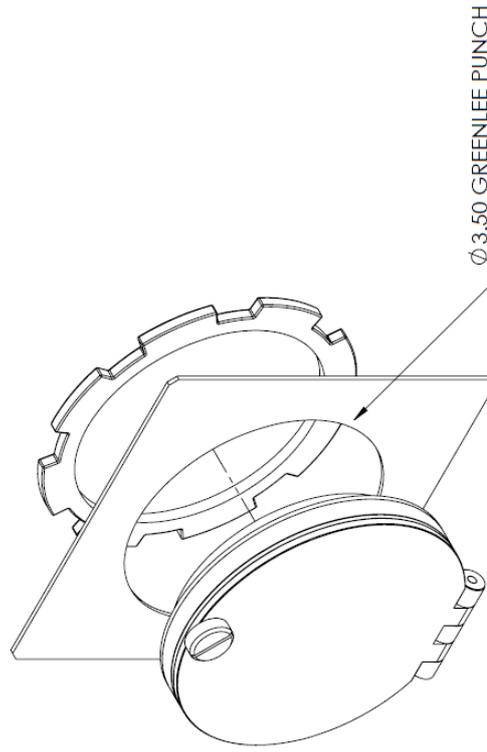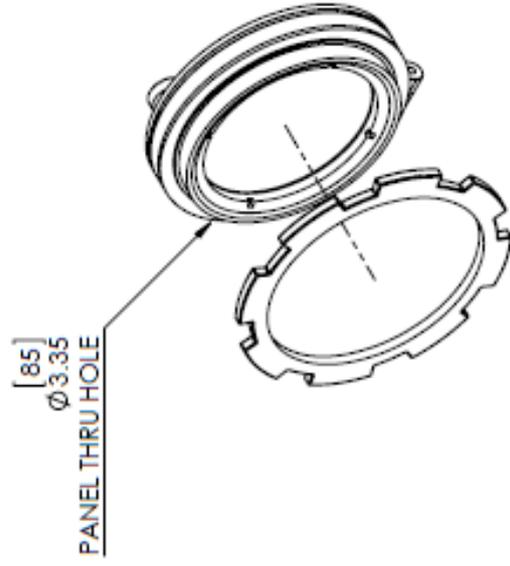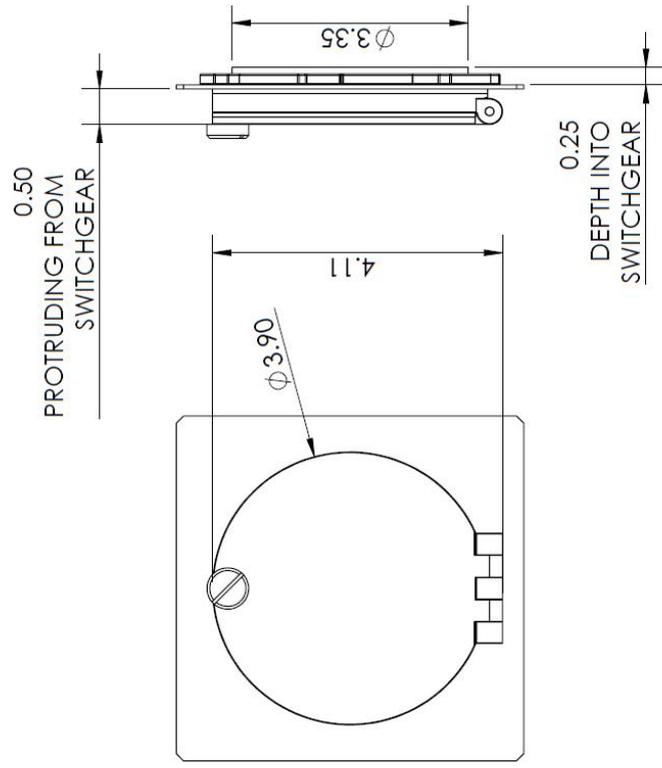

<b>Modified Date</b> Tuesday, November 10, 2015	<b>Modified By</b> T&M Engineering
<b>Description</b> IRW-3C, IRW-3S	
<b>Units</b> Inches (Millimeters)	<b>Scale</b> Not to Scale



**FLIR COMMERCIAL SYSTEMS, INC.**

9 Townsend West, Nashua NH 03063 / Phone: 603.324.7800 / Fax: 603.324.7864

## ***Declaration of Conformity***

**Extech Model:** IRW 2C/2S, 3C/3S, 4C/4S

**Description:** FLIR IR Windows

**Date of Issue:** 16-May-19

We, FLIR Commercial Systems, Inc., 9 Townsend West, Nashua, NH 03063 declare the status of the product above with regard to RoHS/REACH SVHC/PROP-65.

### **RoHS**

**RoHS Status:** Not in Scope

### **REACH SVHC**

**REACH Status:** Compliant

**REACH Directive:** 1907/2006 Article 33 (January 15, 2019)

### **PROP-65**

**Prop-65 Status:** Compliant

Substance List updated November 28, 2018

The product identified above has been tested to the appropriate standards and protocols to guarantee the results as presented.

Attested to by:

A handwritten signature in black ink that reads "Mark Sultzbach". The signature is written in a cursive style and is positioned above a horizontal line.

Mark Sultzbach / QA Manager